


SUBJECT:

RACH-M1 NON-POWER MOUNT  
SEISMIC




# INSTRUCTION SHEET


CAUTION: THE INSTALLATION AND SERVICING OF THIS PRODUCT SHOULD BE PERFORMED BY A QUALIFIED ELECTRICIAN OR SERVICE PERSONNEL

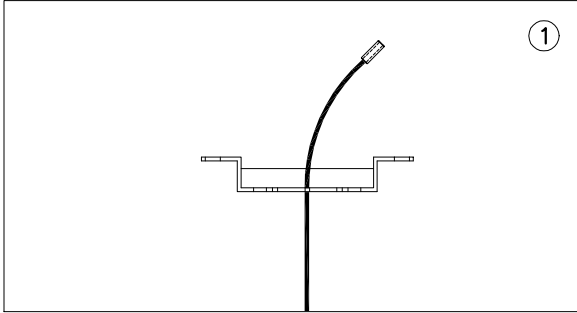


①

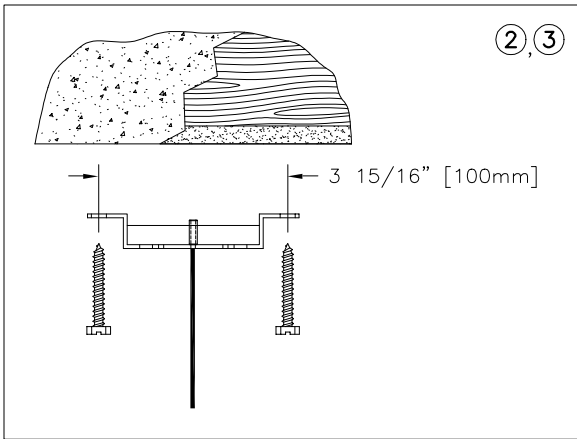


②, ③

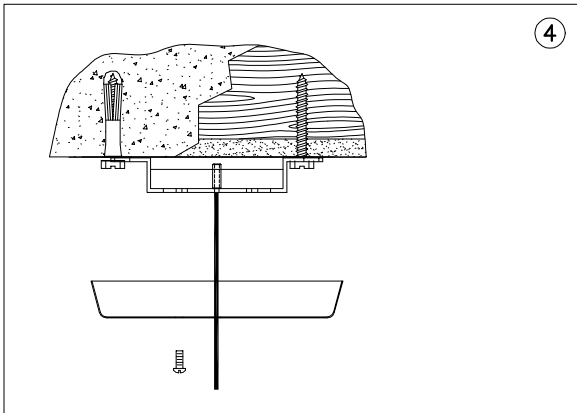

④

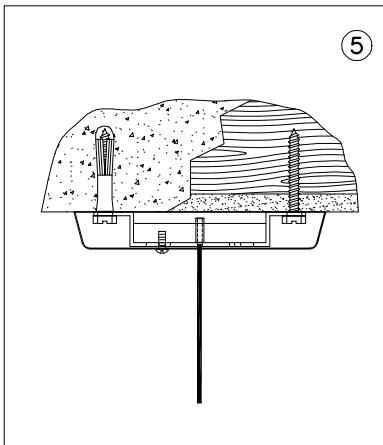

⑤

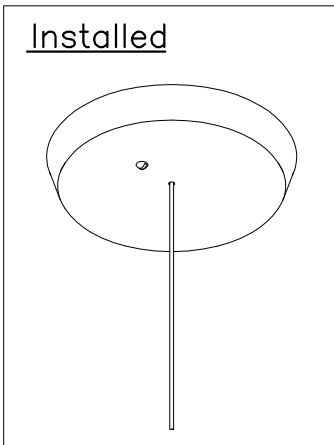

Installed

Mount Installation

Fixture Attachment

- ① Thread crimped aircraft cable through A/C crossbar plate.
- ② Select appropriate fasteners, which will support a load of 750 lbs. each, to attach A/C crossbar plate to structure.
- ③ Secure A/C crossbar plate to location specified on application drawings.
- ④ Feed aircraft cable through center hole in canopy, align the mounting hole in canopy with A/C crossbar plate. Use a #6 x 3/8 in. screw (provided) to secure canopy to mounting plate.
- ⑤ Support fixture sections just above the installed level. Insert free end of aircraft cable into fixture aircraft cable adjuster. After cables have been secured, carefully lower fixture until supported by cable.

**ATTENTION**  
INSTALL IN ACCORDANCE TO NATIONAL AND LOCAL ELECTRICAL CODES AND BUILDING CODES.

**ATTENTION**  
REFER TO ASSOCIATED INSTALLATION INSTRUCTIONS TO COMPLETE INSTALLATION (EG. LEVELING, JOINTING, POWERED AND NON POWERED MOUNTS.)